



ALL DIMENSIONS ARE IN mm & WEIGHTS ARE IN kg UNLESS OTHERWISE SPECIFIED.
FORMAT No. SSEOF/D&D/07

ALL INFORMATION CONTAINED IN THIS DOCUMENT IS CONFIDENTIAL AND THE PROPERTY OF SHIRDI SAI ELECTRICALS Ltd.,
REPRODUCTION OF THIS IN ANY FORM IS TO BE DONE WITH THE SPECIFIC PERMISSION OF THE ORGANISATION.

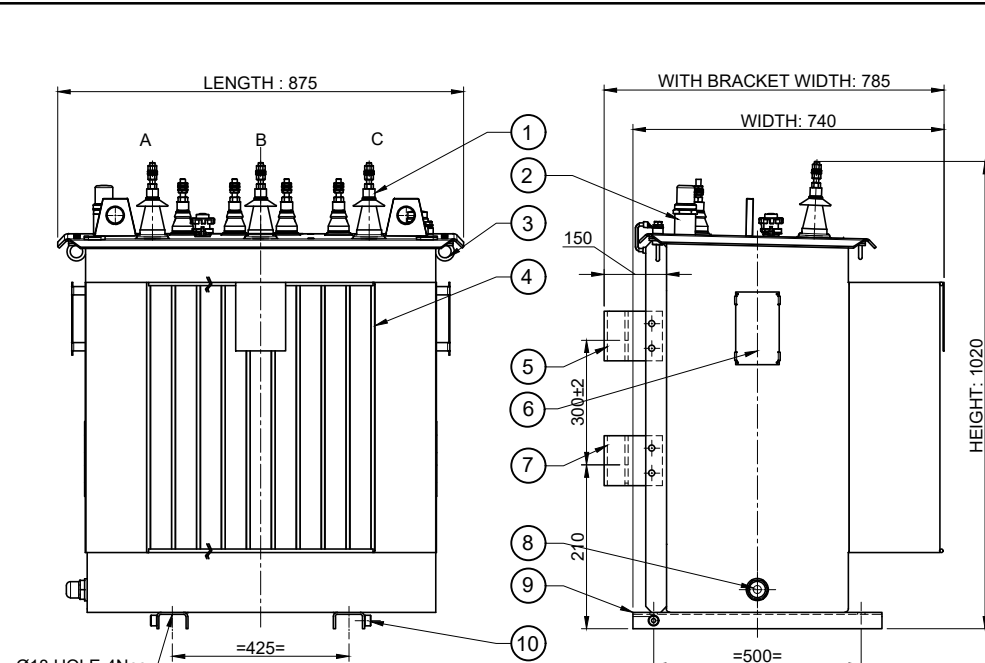

FRONT VIEW


SIDE VIEW

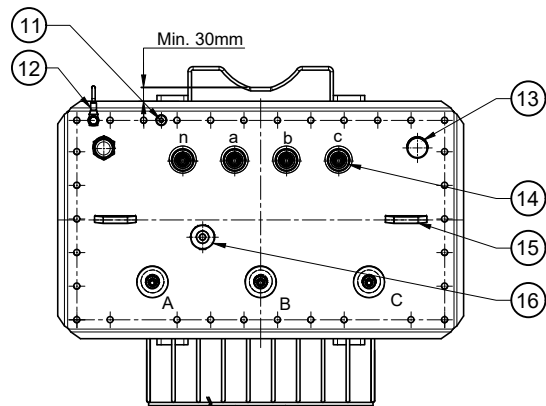

TOP VIEW

NOTE:-

1. THE POSITION AND LOCATION OF FITTINGS & ACCESSORIES MAY SLIGHTLY VARY DURING MANUFACTURING.
2. OVERALL DIMENSIONS AND WEIGHTS ARE SUBJECT TO $\pm 10\%$ TOLERANCE.
HOWEVER, OVERALL DIMENSIONS AND WEIGHTS SHALL NOT EXCEED MAXIMUM LIMITS AS PER SPECIFICATION.
3. PAINT : EXTERIOR PAINT **CEMENT GREY** CONFORMING TO SHADE **RAL 7033**.
4. TOP COVER SHALL BE SLIGHTLY SLOPED TOWARDS HV SIDE.
5. POLE MOUNTING BRACKETS SHALL BE DETACHED DURING DISPATCH.
6. THE TRANSFORMER TANK SHALL HAVE A BOLTED TOP COVER WITH BOLT AND NUT ARRANGEMENT.

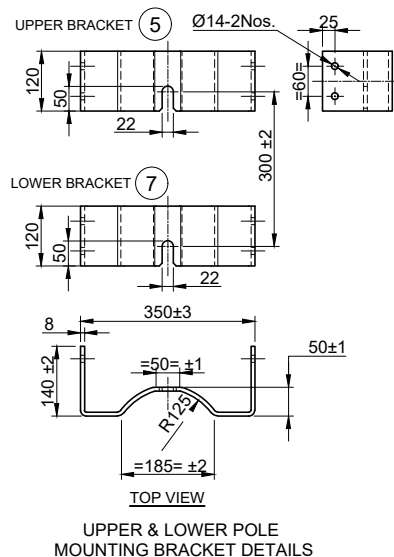

UPPER & LOWER POLE MOUNTING BRACKET DETAILS

S.No.	DESCRIPTION	Qty.
1	H.V PORCELAIN BUSHINGS (3.6kV- 250A)- M12-BRASS STEM	3
2	VERTICAL OIL LEVEL INDICATOR (WITH MIN. & MAX. MARKINGS)	1
3	LASHING EYES	4
4	CORRUGATION PANEL	-
5	UPPER POLE MOUNTING BRACKET	1
6	RATING & TERMINALS MARKING PLATE	1
7	LOWER POLE MOUNTING BRACKET	1
8	OIL DRAINING DEVICE (EN 50216-4, NW:22)	1
9	BASE CHANNEL	2
10	EARTHING TERMINALS (M12)	2
11	L.V NEUTRAL EARTHING BOSS (M12)	1
12	TOP COVER TO TANK EARTHING LINK	1
13	PRESSURE RELIEF VALVE	1
14	L.V PORCELAIN BUSHINGS (1kV- 250A) M12-BRASS STEM	4
15	LIFTING LUGS TO LIFT COMPLETE TRANSFORMER	2
16	TAP CHANGER	1

CUSTOMER : "ONNINEN OY (KESKO GROUP), FINLAND"

TIER 2 LOSSES AS PER COMMISSION REGULATION (EU) No 548/2014

P.O : 4501020805, Dated: 23.11.2022

FG CODE : 832003111639

ONNINEN CODE : CYH285

TOTAL WEIGHT kg: 630 kg

MINIMUM EXTERNAL AIR CLEARANCES		
	HV	LV
PHASE-PHASE	40	40
PHASE-EARTH	40	40

RATING	kVA	50
VOLTAGE	PRI: V	1000
TAPPINGS +5% TO -5% IN STEPS OF 2.5%		
	SEC: V	410
CURRENT	PRI: A	28.87
	SEC: A	70.41
FREQUENCY	HZ:	50

NO. OF PHASES	3
COOLING	ONAN
TEMP. RISE Oil/Wdg. °C	60/65
VECTOR GROUP	Yzn11
SPECIFICATION	IEC 60076

REV.	ZONE	DATE	MODIFICATION	DRAWN	CHECKED	APPROVED

SSE® Shirdi Sai Electricals Limited,
Industrial Development Area,
Kadapa-516002, Andhra Pradesh, India

SCALE : NTS



OUTLINE GENERAL ARRANGEMENT DETAILS
OF 50kVA, 1/0.41kV TRANSFORMERS

WORK ORDER NO : 1188/20

DWG. No.: 3 OG 14007